



MODEL: CSAC-018-C-EXCH¹ _ ² _ ³ _ ⁴

DESCRIPTION:

Single refrigerant circuit / single stage air-cooled portable fluid chiller system setup with additional process system heat exchanger.

CAPACITY		18,000 BTU /HR					
REFRIGERANT CIRCUIT(S)		1					
COMPRESSOR(S) / REFRIGERANT		HERMETIC SCROLL / R454B					
CONDENSER FAN(S) / AIRFLOW		1 / 3147 CFM					
CONDENSER COILS TYPE		ALUMINUM MICROCHANNEL					
EVAPORATOR TYPE		STAINLESS STEEL / COPPER BRAZED PLATE					
HEAT EXCHANGER TYPE		STAINLESS STEEL / COPPER BRAZED PLATE					
FLUID CONNECTIONS		1" MNPT (IN/OUT)					
ELECTRICAL:		COMPRESSOR(S)		FAN	PUMP		
	V - Ø - HZ	RLA	LRA	FLA	FLA	MCA	MOCP
- 2	230 - 1 - 60	16	87.5	3.0	6.6	29.6	45
- 5	230 - 3 - 60	12.8	95	3.0	3.4	22.4	35
- 6 ⁵	460 - 3 - 60	6.4	45	3.0	1.7	12.8	15
CHILLER PUMP HP / OUTPUT		1.0 HP / 30 GPM @ 30 PSI					
TANK SIZE / CONSTRUCTION		25 GALLON / 304 STAINLESS STEEL VENTED TANK WITH LID					
DIMENSIONS		45" L x 32.5" W x 62.3" H					
WEIGHT (APPROX.)		650 LBS					

STANDARD FEATURES:

- **Controls:** Electronic temperature controller with constant Set Point & Process Value temperature readout.
- **Refrigeration Components:** Efficient scroll compressors, sight glass/moisture indicators, balanced port thermal expansion valves, filter driers, service valves, condenser fan(s) are electronically commutated motors. (ECM)
- **Fluid Components:** Heat exchanger for separation of chilled fluid circuit from process fluid circuit. Bronze "Y" strainers with 20 mesh stainless steel screen. Pumps are stainless steel centrifugal. All fluid components insulated. Vented tank includes lid, level sight glass and a fill and drain port. Portable systems will include a manually operated flow control valve.
- **Safety Controls:** High and low refrigerant pressures, high and low fluid temperatures, evaporator freeze condition, low water flow switch, thermal overloads for compressors, and thermal overloads for fan motors, and current/thermal overload motor starter safety for pumps.
- **Construction:** Welded steel powder coated frame and full metal cabinet, copper piping connections.
- **Warranty:** One-year parts / five-year compressor.

SUITABLE AMBIENT CONDITIONS/FEATURES: (see footnote 3)

- **IND:** Indoor use only. Casters on frame, Optional.
- **40:** Suitable for outdoor use with an ambient of 40°F ambient.
- **0:** Suitable for outdoor use to 0°F ambient.
- **M20:** Suitable for outdoor use to -20°F ambient.

Notes:

- System capacity indicated on table is the approximate BTU/hr based on a leaving fluid temperature of 50°F with an ambient air temperature of 95°F.
- All specifications subject to change without notice. Specify voltage and ambient condition upon ordering.
- MCA: Minimum circuit amps per UL 1995. MOCP: Maximum overcurrent protective device per UL 1995.
- Pump outputs based on specific point on the pump curve which varies depending on system.

¹ Flow Design (_ =Portable, ST=Stationary, RF=Reverse Flow, EXCH=Extra Heat Exchanger, DP/DM=Dual Pump Medical, DR=Dual Return)

² Leaving Fluid Temperature (_ =Standard, LT=Low Temperature-specify lowest temperature in °F)

³ Ambient Temperature Conditions (see above)






⁴ Electrical Power Code (see above)

⁵ Unit will require a 4-wire electrical service with neutral. If only 3 phase 3 wire 480-volt service is available, please notify our sales/technical support staff for proper installation procedures.



TECHNICAL SPECIFICATION

WWW.WATERCHILLERS.COM

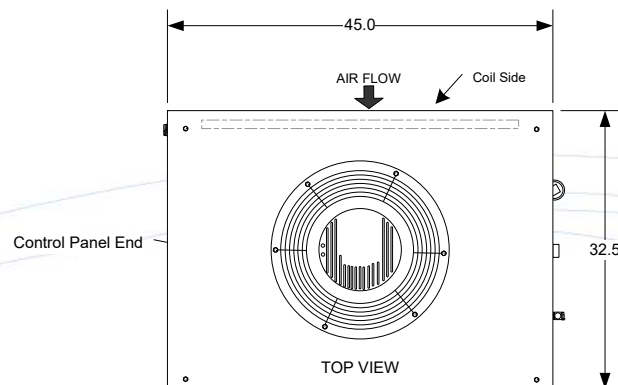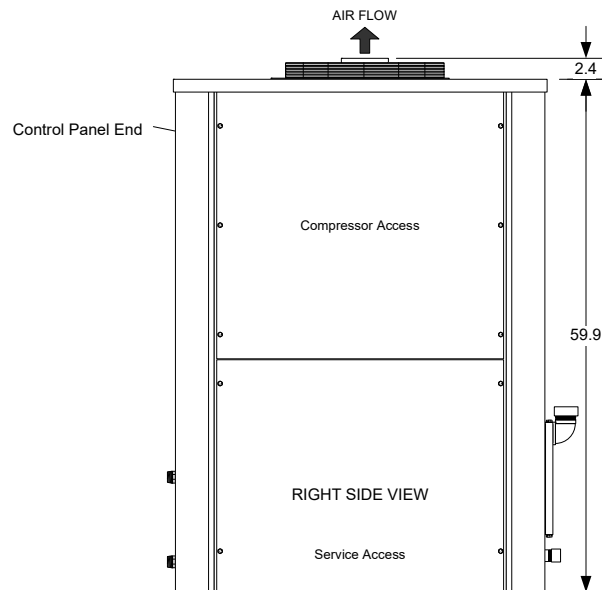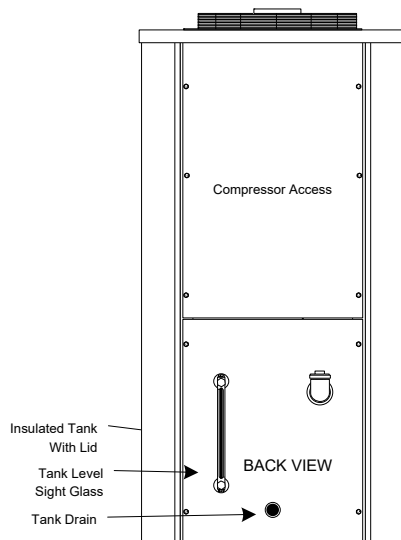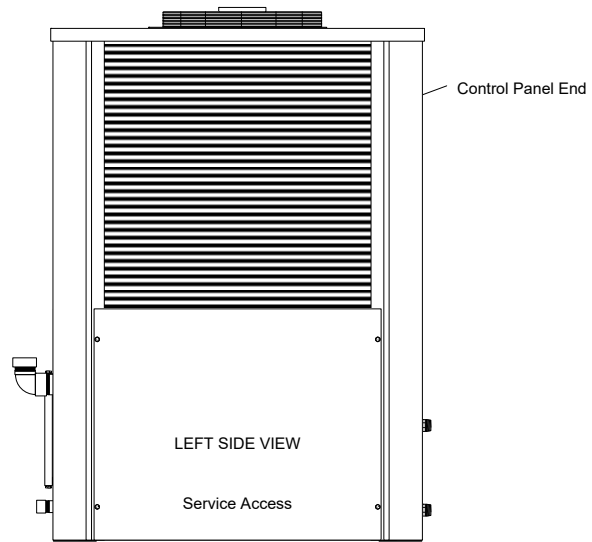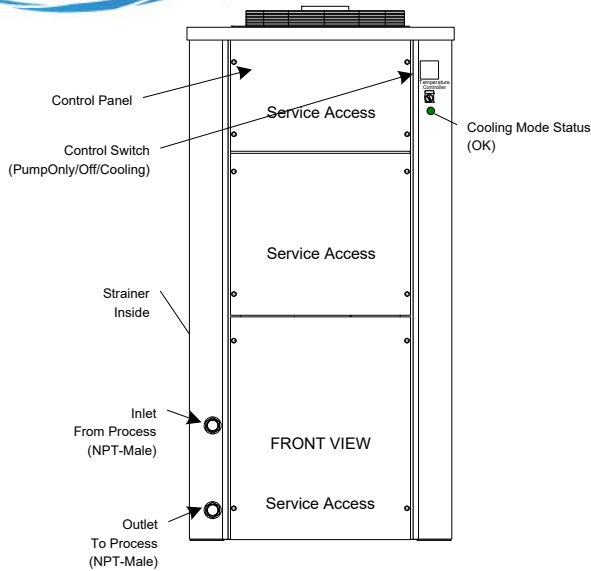

NOTES

- Unit should be installed with at least 2' clearance on all sides and a minimum of 5' clear air space above the unit
- Dimensions are approximate. (inches)
- Casters (Optional)
- All specifications subject to change without notice.

COLD SHOT CHILLERS

DRAWN ENGINEERING

ISSUED 11/14/2023

SIZE

A

DIMENSION NOTES

Dimensions are in inches
Unless otherwise specified, $\pm 1/4"$

DWG NO

INSTALLATION DRAWING
CSAC-018 to 060- (Typical)

REV

1


SCALE .535 in = 1 ft

DWG-INST_CSAC-018 to 060-_022023.vsd


SHEET 7 / Front-Back-Top-Side Views_EXCH



HEAT EXCHANGER (EXCH)

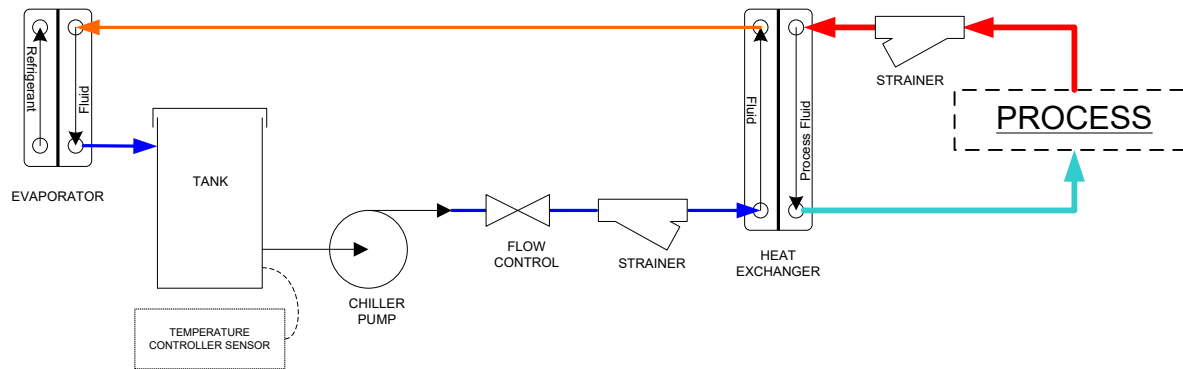

Line Guide



NOTES

- All designs are subject to change without notice.
- The diagrams are to be used as a basic flow diagram only.
- Color Code is for relative temperature comparison.
- Additional components may be included.
- Evaporator may be located in tank.

COLD SHOT CHILLERS

DRAWN ENGINEERING

ISSUED 5/2020

SIZE

A

SCALE NONE

DESCRIPTION

Typical FLOW OPTIONS for Chiller Circuits

REV

1

DWG-CKT_ChillerCircuitFlowOptions-Typical_(0520).vsd

SHEET 2 / Heat Exchanger (EXCH)